

# Evidence of Performance

## Airborne sound insulation of building elements

Test report 163 38760/2e

This is a translation of the test report 163 38760/2 of 19<sup>th</sup> June 2009.




Client **Press Glas S.A.**  
**Nowa Wies**  
Kopalniana 9

42-262 Poczesna  
Poland

### Basis

EN ISO 140-1:1997+A1:2004  
EN 20140-3 :1995+A1:2004  
EN ISO 717-1 : 1996+A1:2006

### Representation

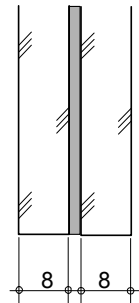

### Informations for use

This test report may be used to validate the sound insulation of a building element.

Validity for germany:

$R_w$  corresponds to  $R_{w,P}$  for DIN 4109 Annex 1 table 40 a

Product	Laminated glass
Designation	88.2 kl. P2A
Size (w × h)	1230 mm × 1480 mm
Construction	16 mm LSG
Area related weight	40 kg/m <sup>2</sup>
Special items	-/-

### Validity

The data and results given relate solely to the described, tested object.

Testing the acoustic properties does not allow any statement to be made on further characteristics of the present structure which could define performance and quality.

Weighted sound reduction index  $R_w$   
Spectrum adaptation terms C and  $C_{tr}$



$$R_w (C; C_{tr}) = 39 (-1; -3) \text{ dB}$$

### Notes on publication

The **ift** Guidance Sheet "Conditions and Guidance for the use of **ift** Test Documents" applies.

The cover sheet can be used as a summary.

### Contents

This test report includes 6 pages

- 1 Test specimen
  - 2 Test procedure
  - 3 Test results
  - 4 Instructions for use
- Data sheet (1 page)

ift Rosenheim  
01 July 2009

*J. Hessinger*

Dr. Joachim Hessinger, Dipl.-Phys.  
Head of Testing Department  
ift Centre for Acoustics

*Bernd Saß*

Bernd Saß, Dipl.-Ing. (FH)  
Assistant Head of Testing Department  
ift Centre for Acoustics

